



INSTALLATION PROCEDURES:

- A. ALL UNITS ARE IN MILLIMETRES UNLESS OTHERWISE SPECIFIED.
- B. REFER TO GCS0038 FOR TREE PROXIMITY SPECIFICATION.
- C. OUTDOOR PADMOUNTED TRANSFORMERS SHALL BE LOCATED/INSTALLED AS PER THE ONTARIO ELECTRICAL SAFETY CODE, SECTION 26-242.
- D. MINIMUM CLEARANCE REQUIRED FOR GAS MAIN IN 4 PARTY J.U.T. IS 1000mm FROM ANY BUILDING FOUNDATION/STAIRS.

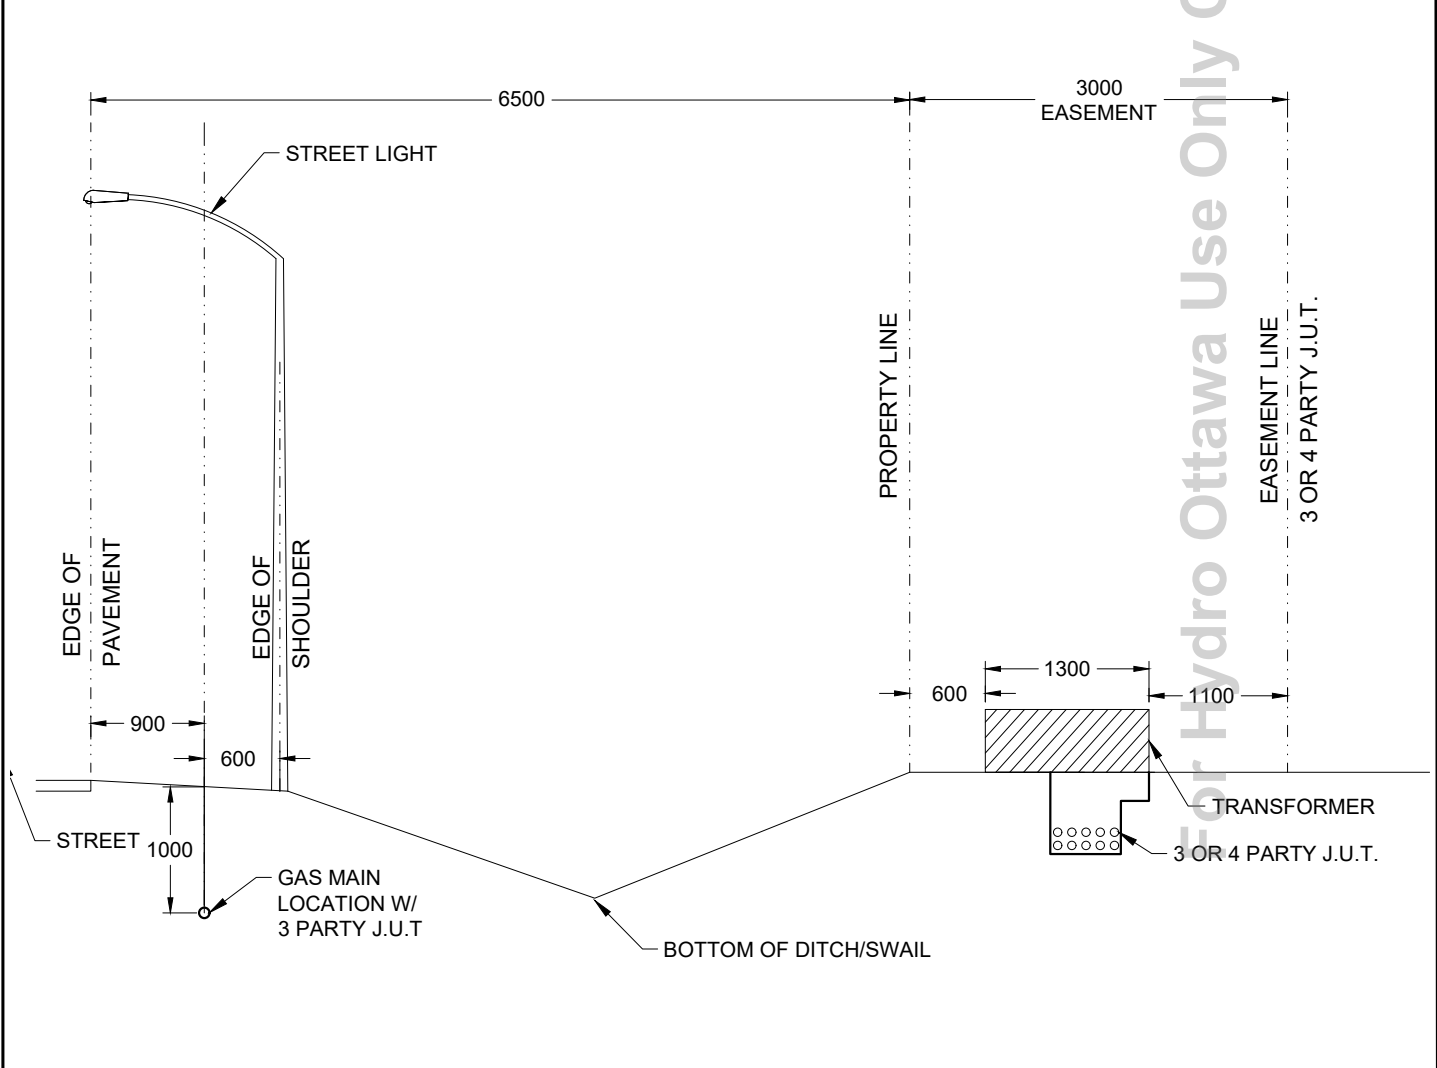

G:\4.2.3 TECH STD & MAT\01 STDS\01 HOLIG-GENERAL\CONSTRUCTION\GCG0005 R1 RURAL ESTATE LOT XFMR AND TRENCH LOCATION.DWG

REVISIONS				PREP	CHKD	APPD	TITLE	
REV: 1	DATE: 2020-02-21	EV	AK	BDH	 www.hydroottawa.com		ENGINEERING SPECIFICATION	
CHANGE:	MODIFIED DUCT LAYOUT FROM 3x3 TO 2x5 MOVED GAS MAIN LOCATION						RURAL ESTATE LOT XFMR AND TRENCH LOCATION	
REV: CHANGE:	DATE:						CONSTRUCTION DETAIL	
REV: CHANGE:	DATE:				PREP: G. MOLNAR	NO: GCG0005	1 OF 1 REV: 1	
					CHKD: K. McROBERTS			
					APPD: C. MALONE P. Eng			
					DATE: 2008-11-05			
					SCALE: N.T.S. @ ANSI A			